


Installation Instructions

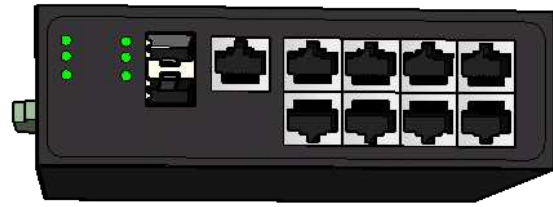


- This product is designed to be wall mounted or DIN rail mounted
- Use CAT 5e or CAT 6 or better cables
- The device needs sufficient cooling to operate at maximum power output. Refer to the online manual for specification
- Allow for sufficient airflow around the device

For installation, wiring, and configuration information, please refer to the on-line technical manual for this device by scanning this QR code or visiting:

https://www.poetexas.com/gbts-10-8-m_rev2/



Installation Options

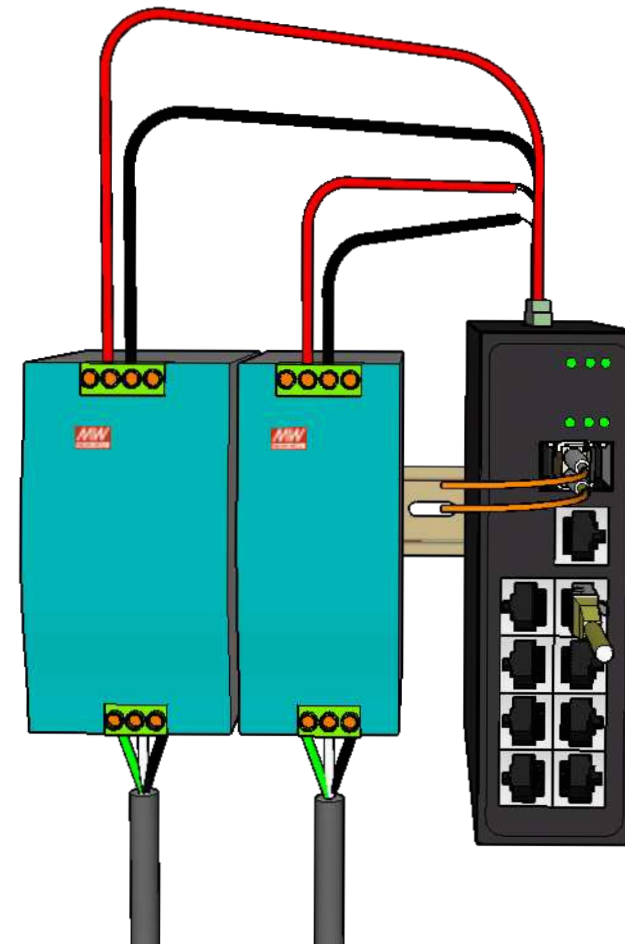


DIN Mounted with PS-48v480w and PS-48v240w

SWITCH SIDE	WIRE COLOR	POWER SUPPLY SIDE
V1 P+	RED	V+
V1 P-	BLACK	V-
V2 P+	RED	V+
V2 P-	BLACK	V-

AC POWER	WIRE COLOR	POWER SUPPLY SIDE
120 VAC 50/60Hz Minimum 1 amps	WHITE	N
	BLACK	L
	GREEN	GROUND

Installation Notes:

- Properly tighten set screws to hold cables in switch and power supply

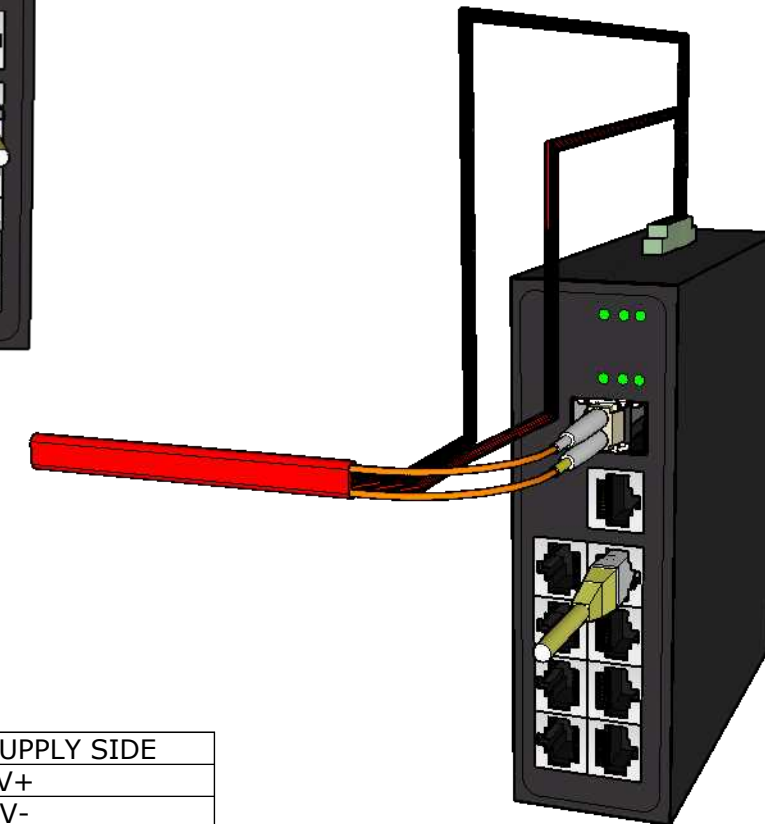

Wall Mounted with Remote Power

**GBTS-10-8-M
Installation Drawings**

3616 Far West Blvd
Suite 117-294
Austin TX 78731

DATE:
November 1, 2022

TITLE:
**PRODUCT
DRAWINGS**

DRAWING NUMBER:

A